


# WIRING DIAGRAM

## UZC4 ZONE THERMOSTAT INPUTS

DIP SWITCH SETTINGS	
HP<SYSTEM>GAS -	<input checked="" type="checkbox"/> *
DF<HP>CONV -	<input checked="" type="checkbox"/> *
OFF<FAN DLY>ON -	<input checked="" type="checkbox"/> *
90s<PURGE>120s -	<input checked="" type="checkbox"/> *
OAS<STAGES>TMR -	<input checked="" type="checkbox"/> *
OFF <50%R> ON -	<input checked="" type="checkbox"/> *
OFF <SAS> ON -	<input checked="" type="checkbox"/> *
GAS <FAN> HYDRO -	<input checked="" type="checkbox"/> *
BANK1	
HC <TSTAT> HP -	<input checked="" type="checkbox"/> *
1 <CS#> 2 - - -	<input checked="" type="checkbox"/> *
0 <RV> B - - -	<input checked="" type="checkbox"/> *
OFF <ZDL> ON -	<input checked="" type="checkbox"/> *
RA <AUX RLY> DA -	<input checked="" type="checkbox"/> *
OFF <RAS> ON - -	<input checked="" type="checkbox"/> *
0 <RA LMT> +10 -	<input checked="" type="checkbox"/> *
ANY <FAN CTRL> Z1 -	<input checked="" type="checkbox"/> *
BANK2	
* REQUIRED SETTING	

NOTE: TIMER POTENTIOMETER  
MUST BE SET TO "OFF"

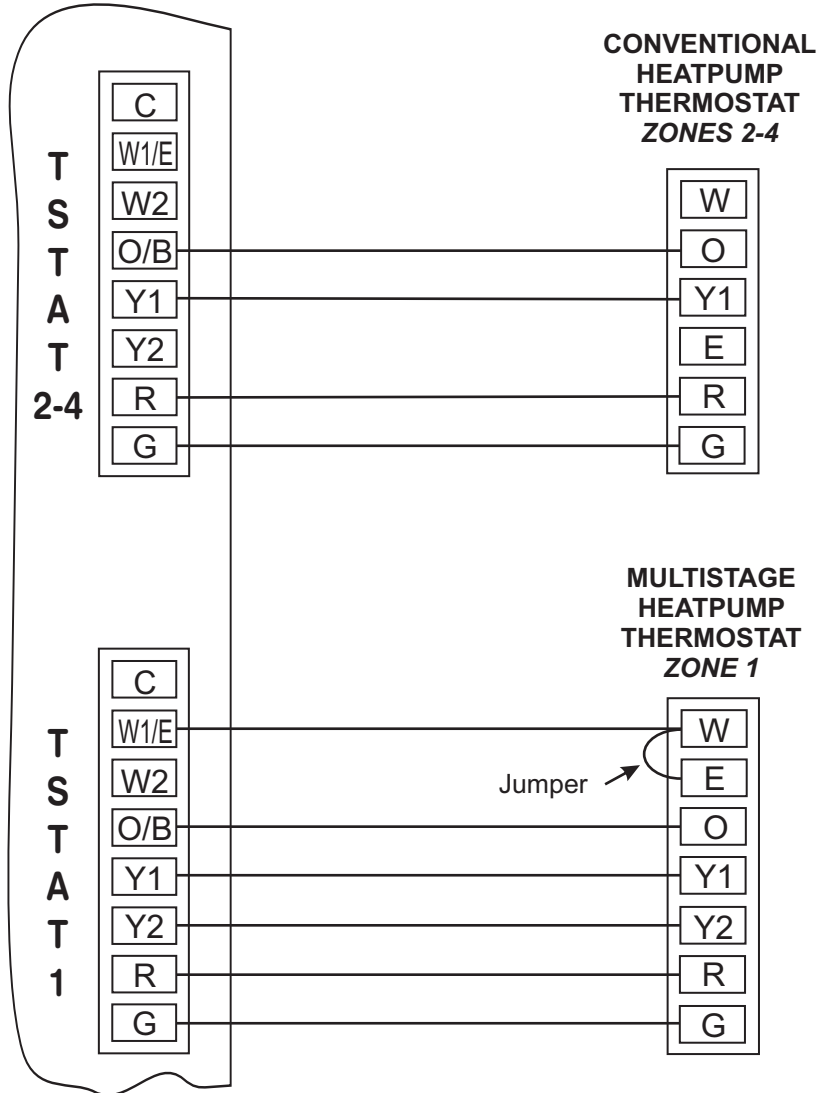

# EWC<sup>®</sup>

CONTROLS INC.

Englishtown, NJ 07726

DRAWING BY:  
PJC

DWG NAME: MODEL UZC4 -- ZONE 1 AS STAGING MASTER

DATE:  
09/10/08

SIZE:  
A

REV:  
A

DWG NO:  
090512A0151

SHEET: 1 OF 1

COPYRIGHT © EWC CONTROLS INC.  
ALL RIGHTS RESERVED

DISCLAIMER: EWC Controls Inc., Cannot be held liable for the use or misuse of this supplied information. It is the responsibility of the user to determine the suitability of the application. Malfunctions, improper operation, and/or subsequent damage to any related equipment or property damage as a result of using this supplied information is the responsibility of the user. EWC Controls Inc., is not responsible for any misapplications including, but not limited to negligence, defect in product(s), system incompatibility, poor workmanship and/or installation.