
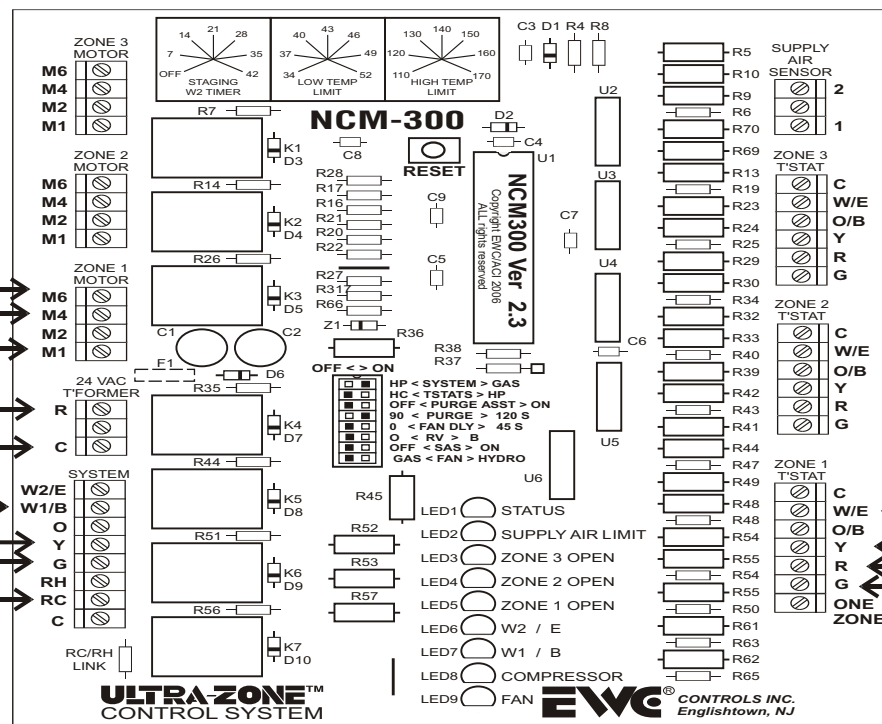


# REPLACE ST-2E/ST-3E WITH NEW NCM 300

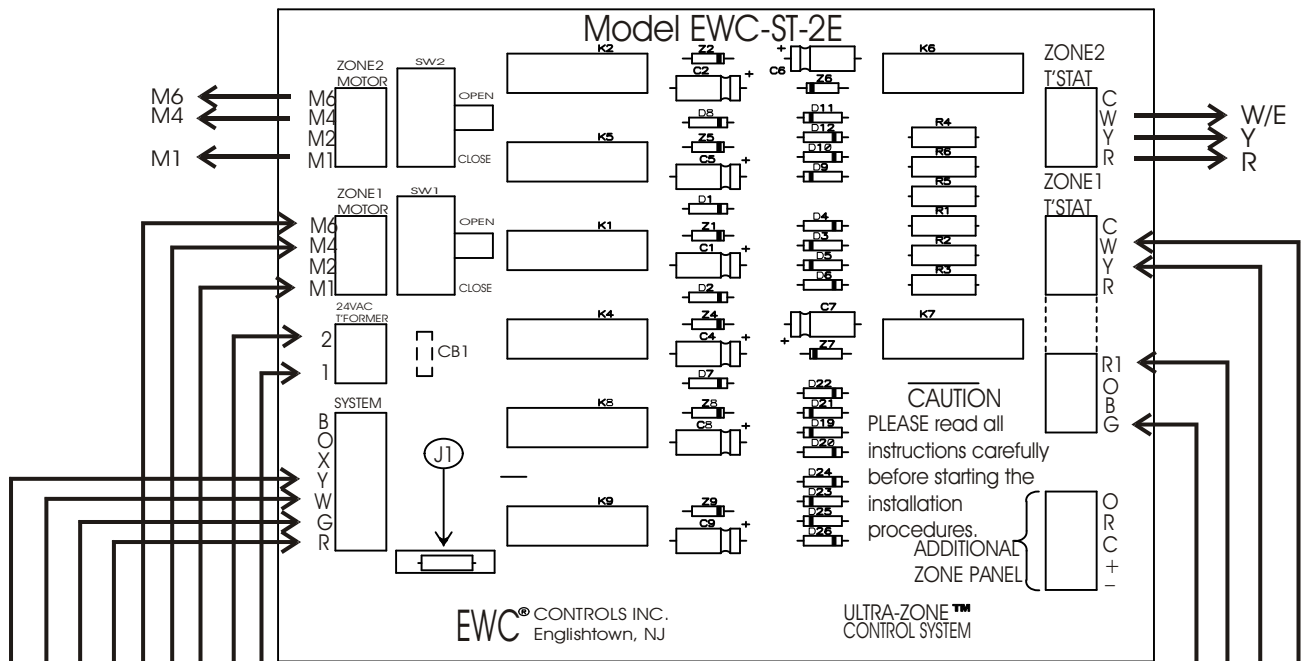

1. Terminals "O" and "B" from Zone 1 Thermostat will no longer be used.
2. You may use the "O" or "B" wire as the new 24V common wire for the new thermostat.
3. Zone 1 and Zone 2 will now function independently.
4. Zone 2 and Zone 3 damper and thermostat wiring not shown for clarity.

 <b>EWC</b> CONTROLS INC. Englishtown, NJ 07726 Form# 600114A0001A	Drawn By: <b>LYT</b>	Approved By: <b>JPB</b>	Date: <b>1/23/17</b>	Drawing Name: <b>REPLACE ST2E/3E WITH NEW NCM-300</b>
	Size: <b>A</b>	Rev: <b>A</b>	Dwg No: <b>090512A0369</b>	DISCLAIMER: EWC Controls Inc., Cannot be held liable for the use or misuse of this supplied information. It is the responsibility of the user to determine the suitability of the application. Malfunctions, improper operation, and/or subsequent damage to any related equipment or property damage as a result of using this supplied information is the responsibility of the user. EWC Controls Inc., is not responsible for any misapplications including, but not limited to negligence, defect in products(s), system incompatibility, poor workmanship and/or installation.
	Sheet: <b>1 of 1</b>	COPYRIGHT © EWC CONTROLS INC. ALL RIGHTS RESERVED		